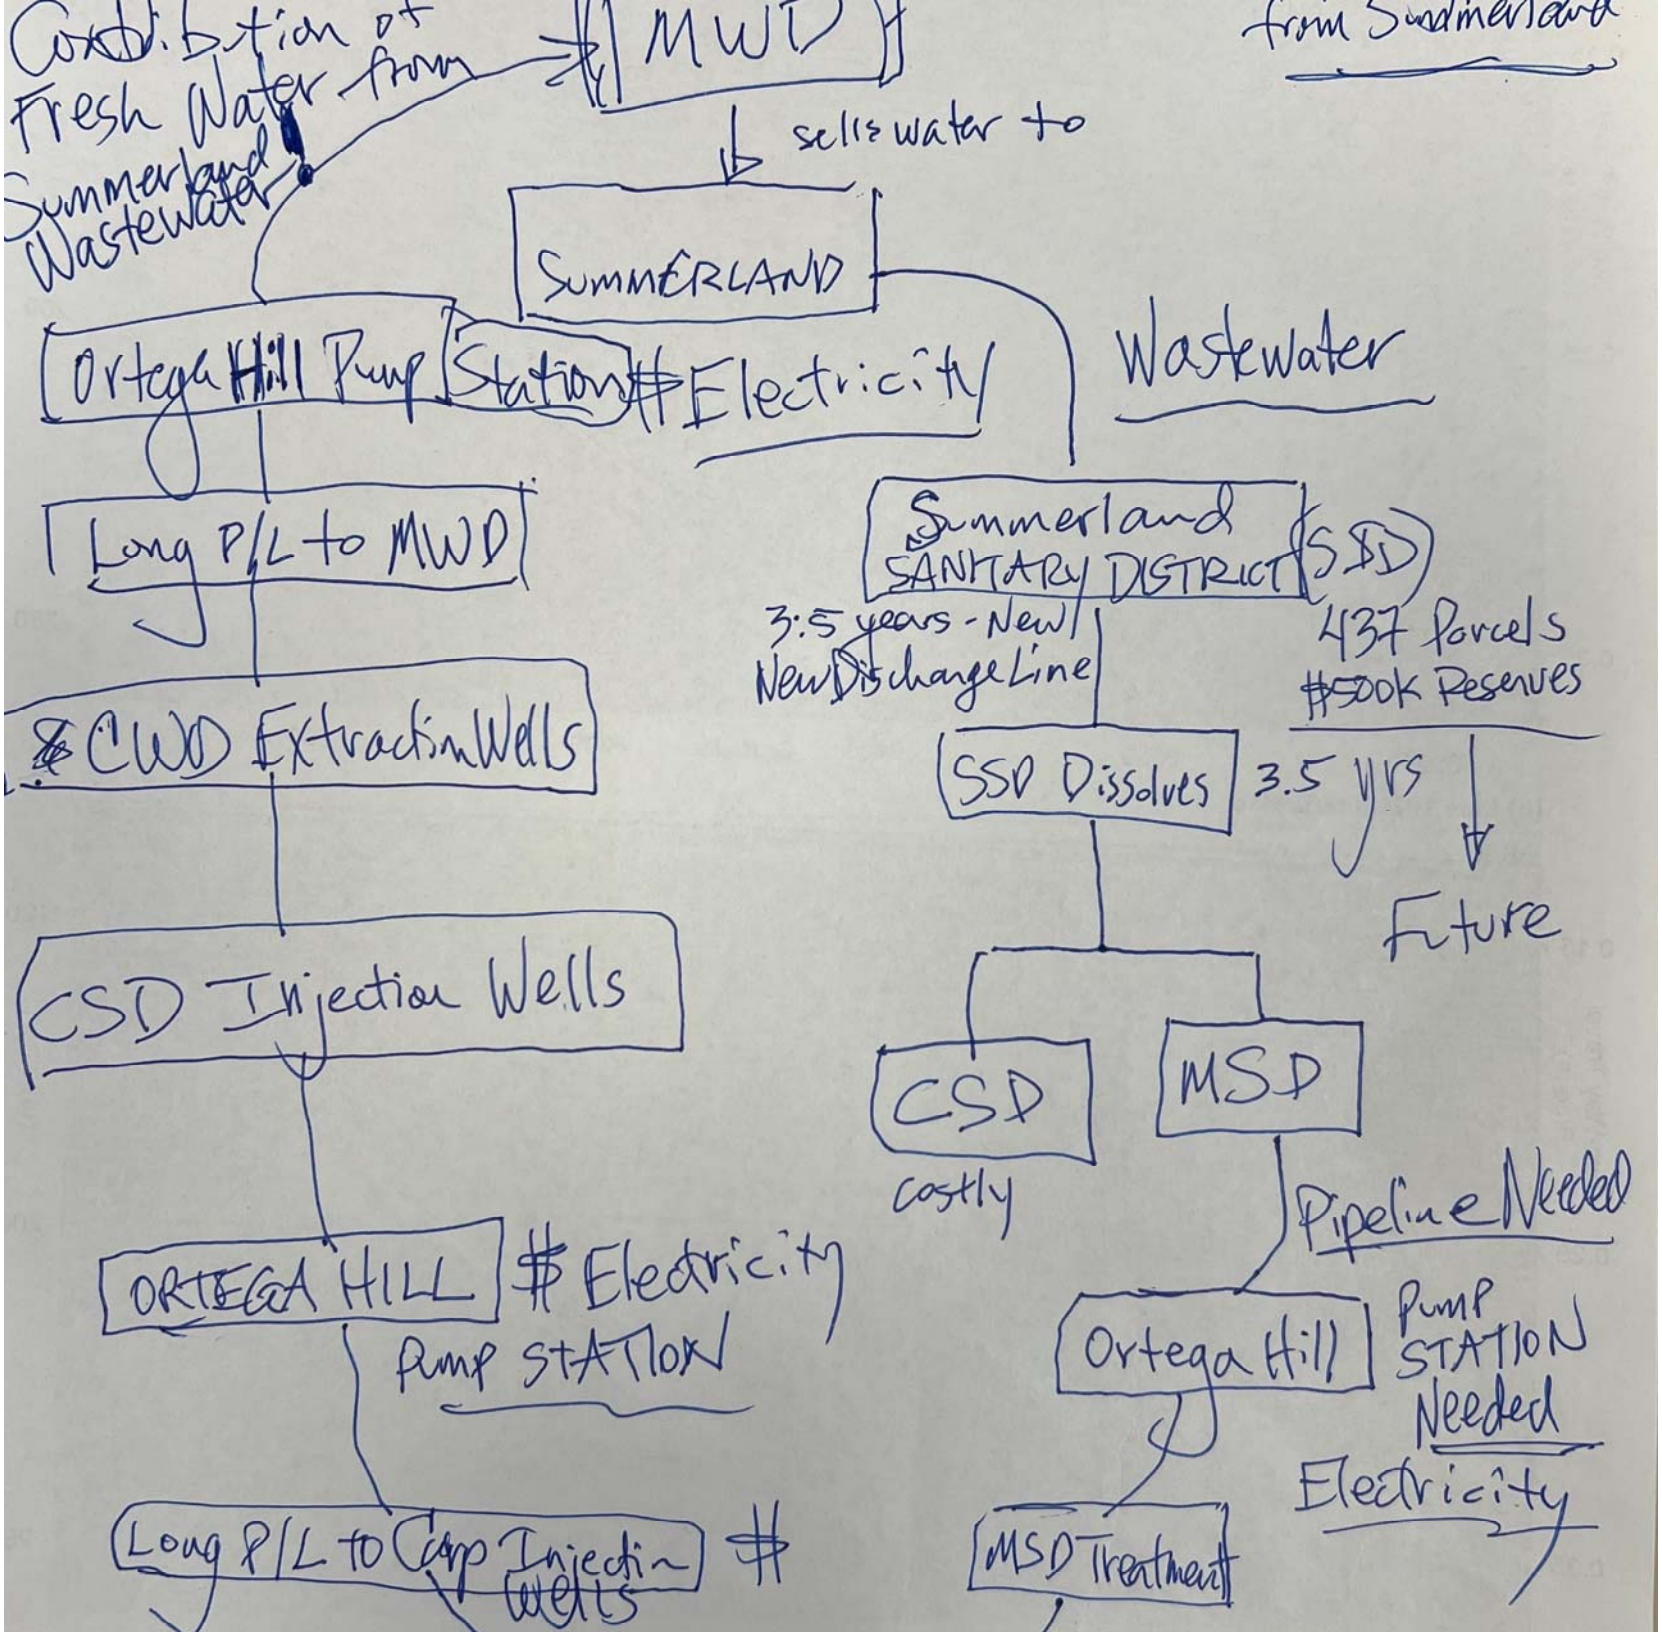
Contribution of Fresh Water from Summerland Wastewater
MWD
sells water to
SUMMERLAND
Ortega Hill Pump Station
Electricity
Wastewater
Long P/L to MWD
CWD Extraction Wells
CSD Injection Wells
ORTEGA HILL
Electricity
Pump STATION
Long P/L to Carp Injection Wells
from Summerland
Summerland SANITARY DISTRICT (SSD)
3.5 years - New New Discharge Line
437 Parcels
500k Reserves
SSD Dissolves
3.5 yrs
Future
CSD
costly
MSD
Pipeline Needed
Ortega Hill
Pump STATION Needed
Electricity
MSD Treatment